

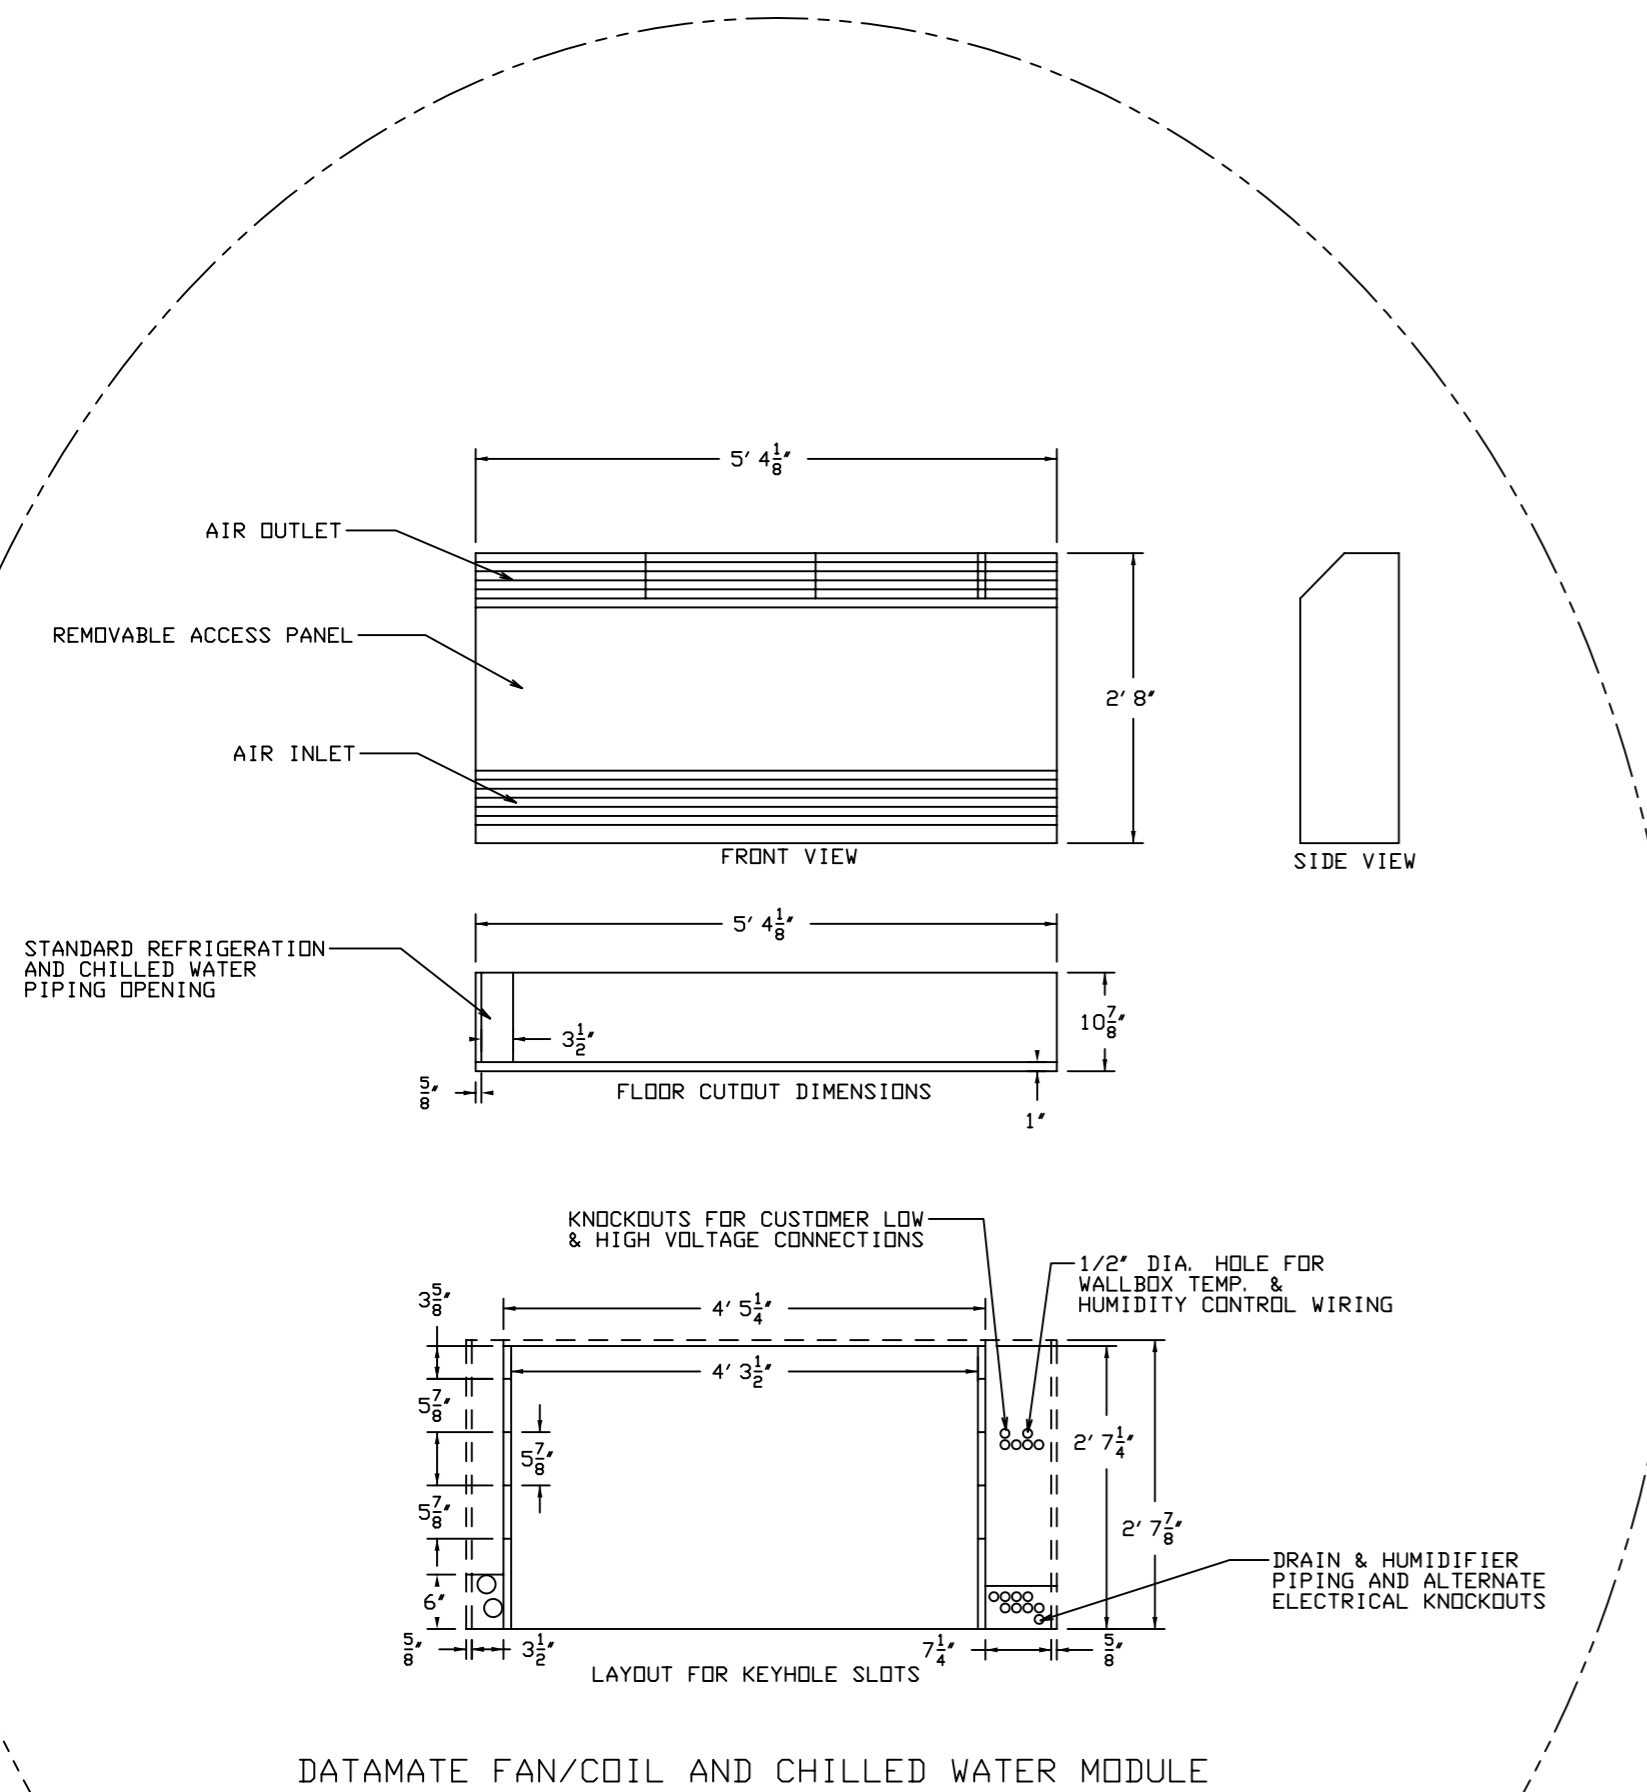


NOTE:  
 ALL CAT V CABLES AND POWER WIRING WILL  
 PENETRATE VAULT WALLS THROUGH CABLE TRAY  
 LOCATIONS AND RUN ALONG WIRE MANAGEMENT  
 RAIL SYSTEM ONCE INSIDE VAULT, WIRES  
 DROP DOWN FROM RAILS INTO SERVERS

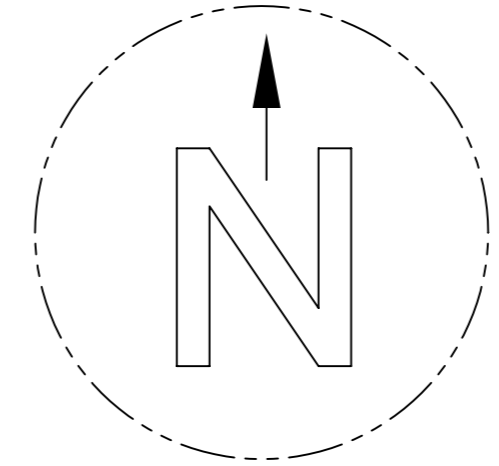

DATAMATE FAN/COIL AND CHILLED WATER MODULE

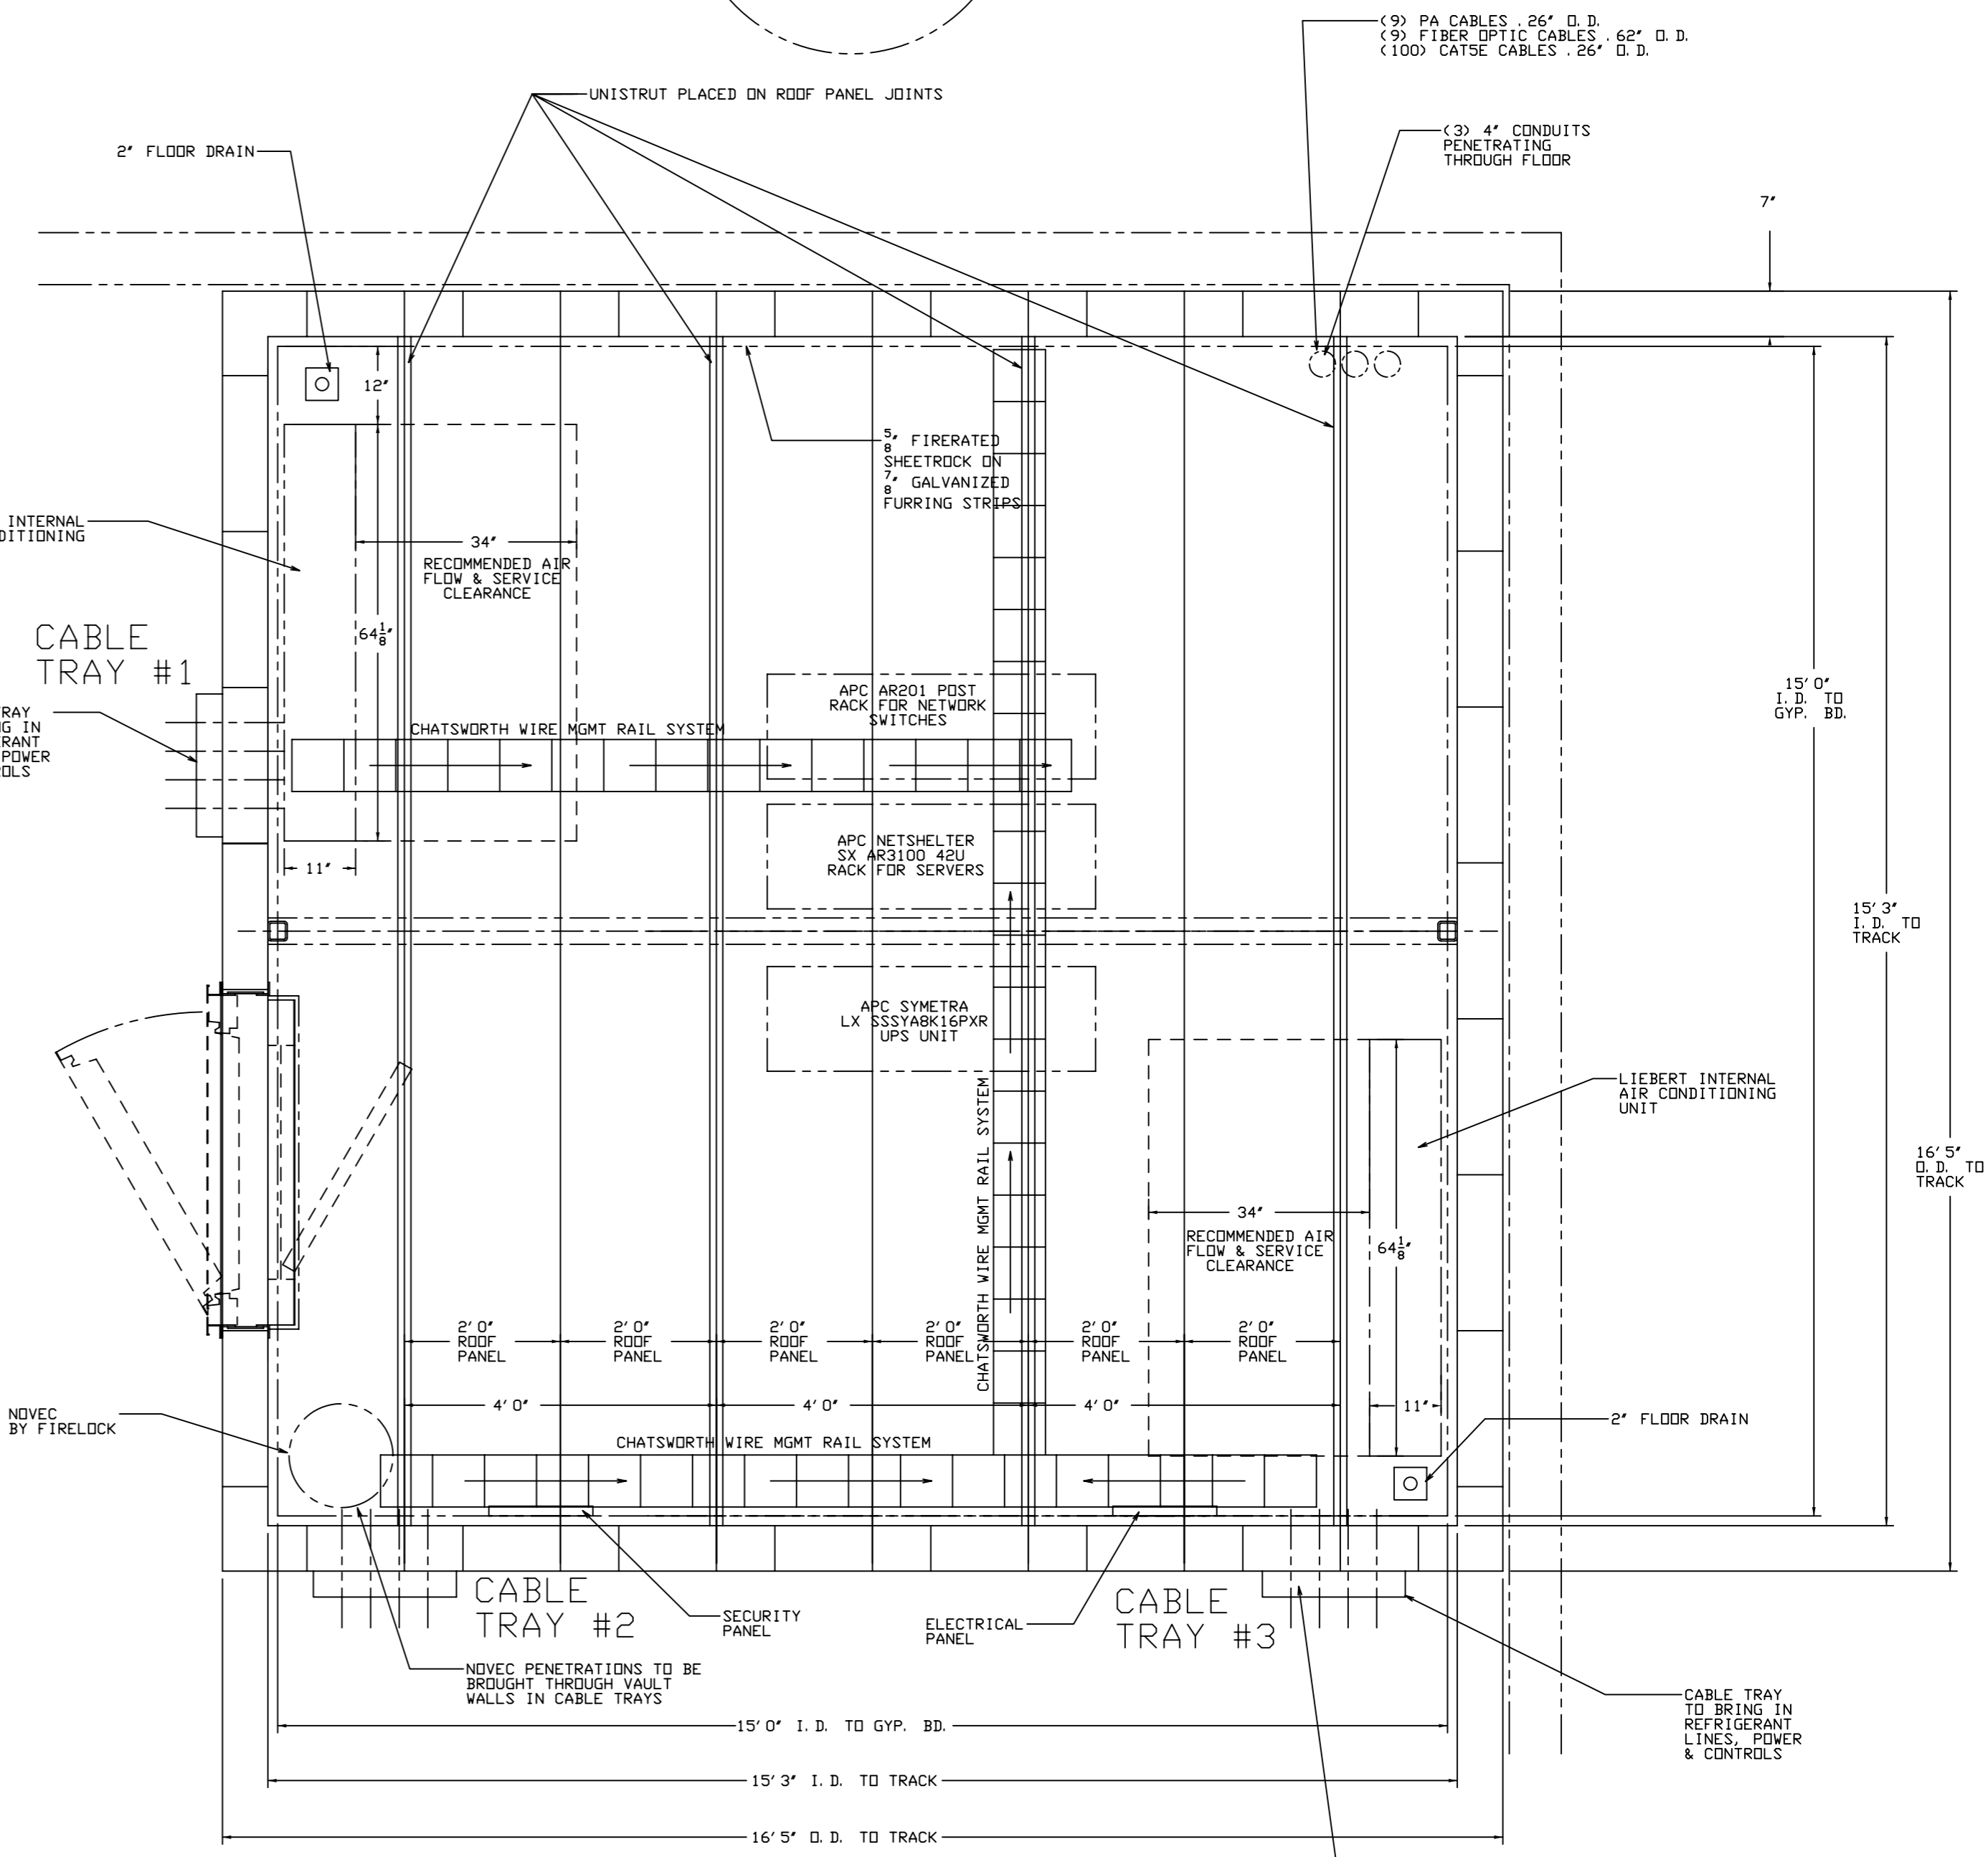

ALL ADDITIONAL PENETRATIONS ARE  
 TO BE THROUGH ONE OF THE THREE

CCTV (25) COAXIAL CABLES 0.35" DIA.  
 SECURITY (75) CABLES 0.20" DIA  
 FIRE ALARM (1) CABLE FOR LOOP

4" CONDUITS FOR POWER,  
 SECURITY & OTHER  
 PENETRATIONS THROUGH  
 CABLE TRAYS